Additional Resources: Product Page



MODEL: CP100-40635 | DESCRIPTION: PELTIER MODULE

FEATURES

- arcTEC™ structure
- silicone sealed
- wide ΔT max
- dual stage module
- precise temperature control
- solid state construction



.....

SPECIFICATIONS

parameter	conditions/description	min	typ	max	units
input voltage ¹				16.1	V
input current ²				10	А
internal resistance ³		1.22	1.36	1.50	Ω
Qmax⁴	Th = 27°C Th = 50°C			62 68	W W
∆Tmax⁵	Th = 27°C Th = 50°C			85 95	°C °C
solder melting temperature	connection between thermoelectric pairs	235			°C
assembly compression				1	MPa
hot side plate				100	°C
RoHS	Ves				

RoHS

1. Maximum voltage at Δ T max and T_b=27°C Notes:

.....


2. Maximum current to achieve ΔT max

2. Maximum current of a time of a t


MECHANICAL DRAWING

units: mm

ITEM	DESCRIPTION	MATERIAL	PLATING/COLOR	
1	ceramic plate	96% AL ₂ D ₃	white	
2	sealer	silicon rubber 703 RTV (between cold and hot side plates)		
3	marking	P/N & S/N printed or	n cold side surface	
4	wire leads	20 AWG (105°C max)	tin	
5	joint cover	silicon rubber 703 R	TV	

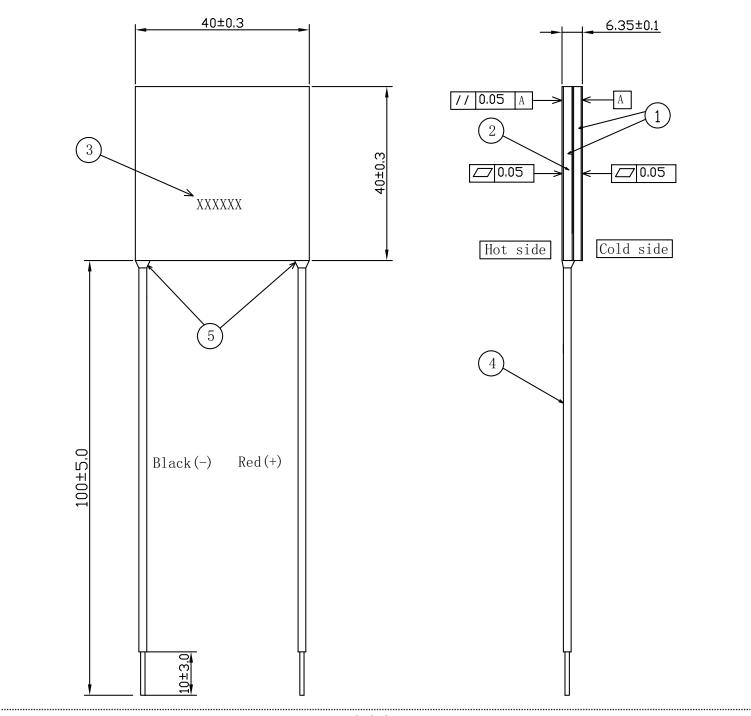


PERFORMANCE (Th=27°C)

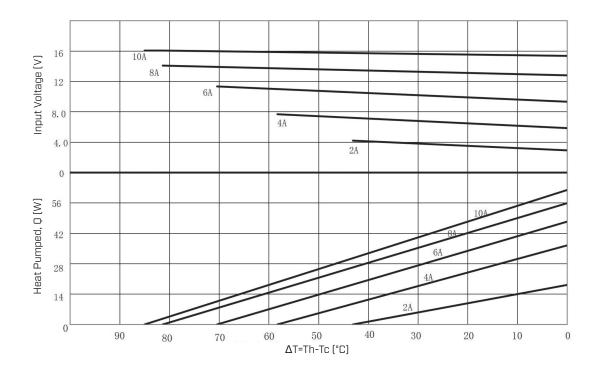

PERFORMANCE (Th=50°C)

.....

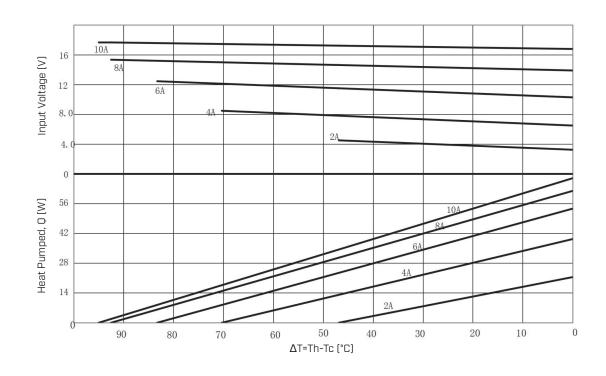

REVISION HISTORY

rev.	description	date
1.0	initial release	10/10/2024

The revision history provided is for informational purposes only and is believed to be accurate.

Same Sky offers a one (1) year limited warranty. Complete warranty information is listed on our website.

same sky

Same Sky reserves the right to make changes to the product at any time without notice. Information provided by Same Sky is believed to be accurate and reliable. However, no responsibility is assumed by Same Sky for its use, nor for any infringements of patents or other rights of third parties which may result from its use.

Same Sky products are not authorized or warranted for use as critical components in equipment that requires an extremely high level of reliability. A critical component is any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.